


A-105
C. Amel
New Comp
E-2

DRAWING NUMBER
PLANNED DEPARTMENT - ONE CALIFORNIA
REVISIONS TO DRAWING

DRAWING NUMBER
ONE CALIFORNIA
REVISIONS TO DRAWING

DRAWING NUMBER
ONE CALIFORNIA
REVISIONS TO DRAWING

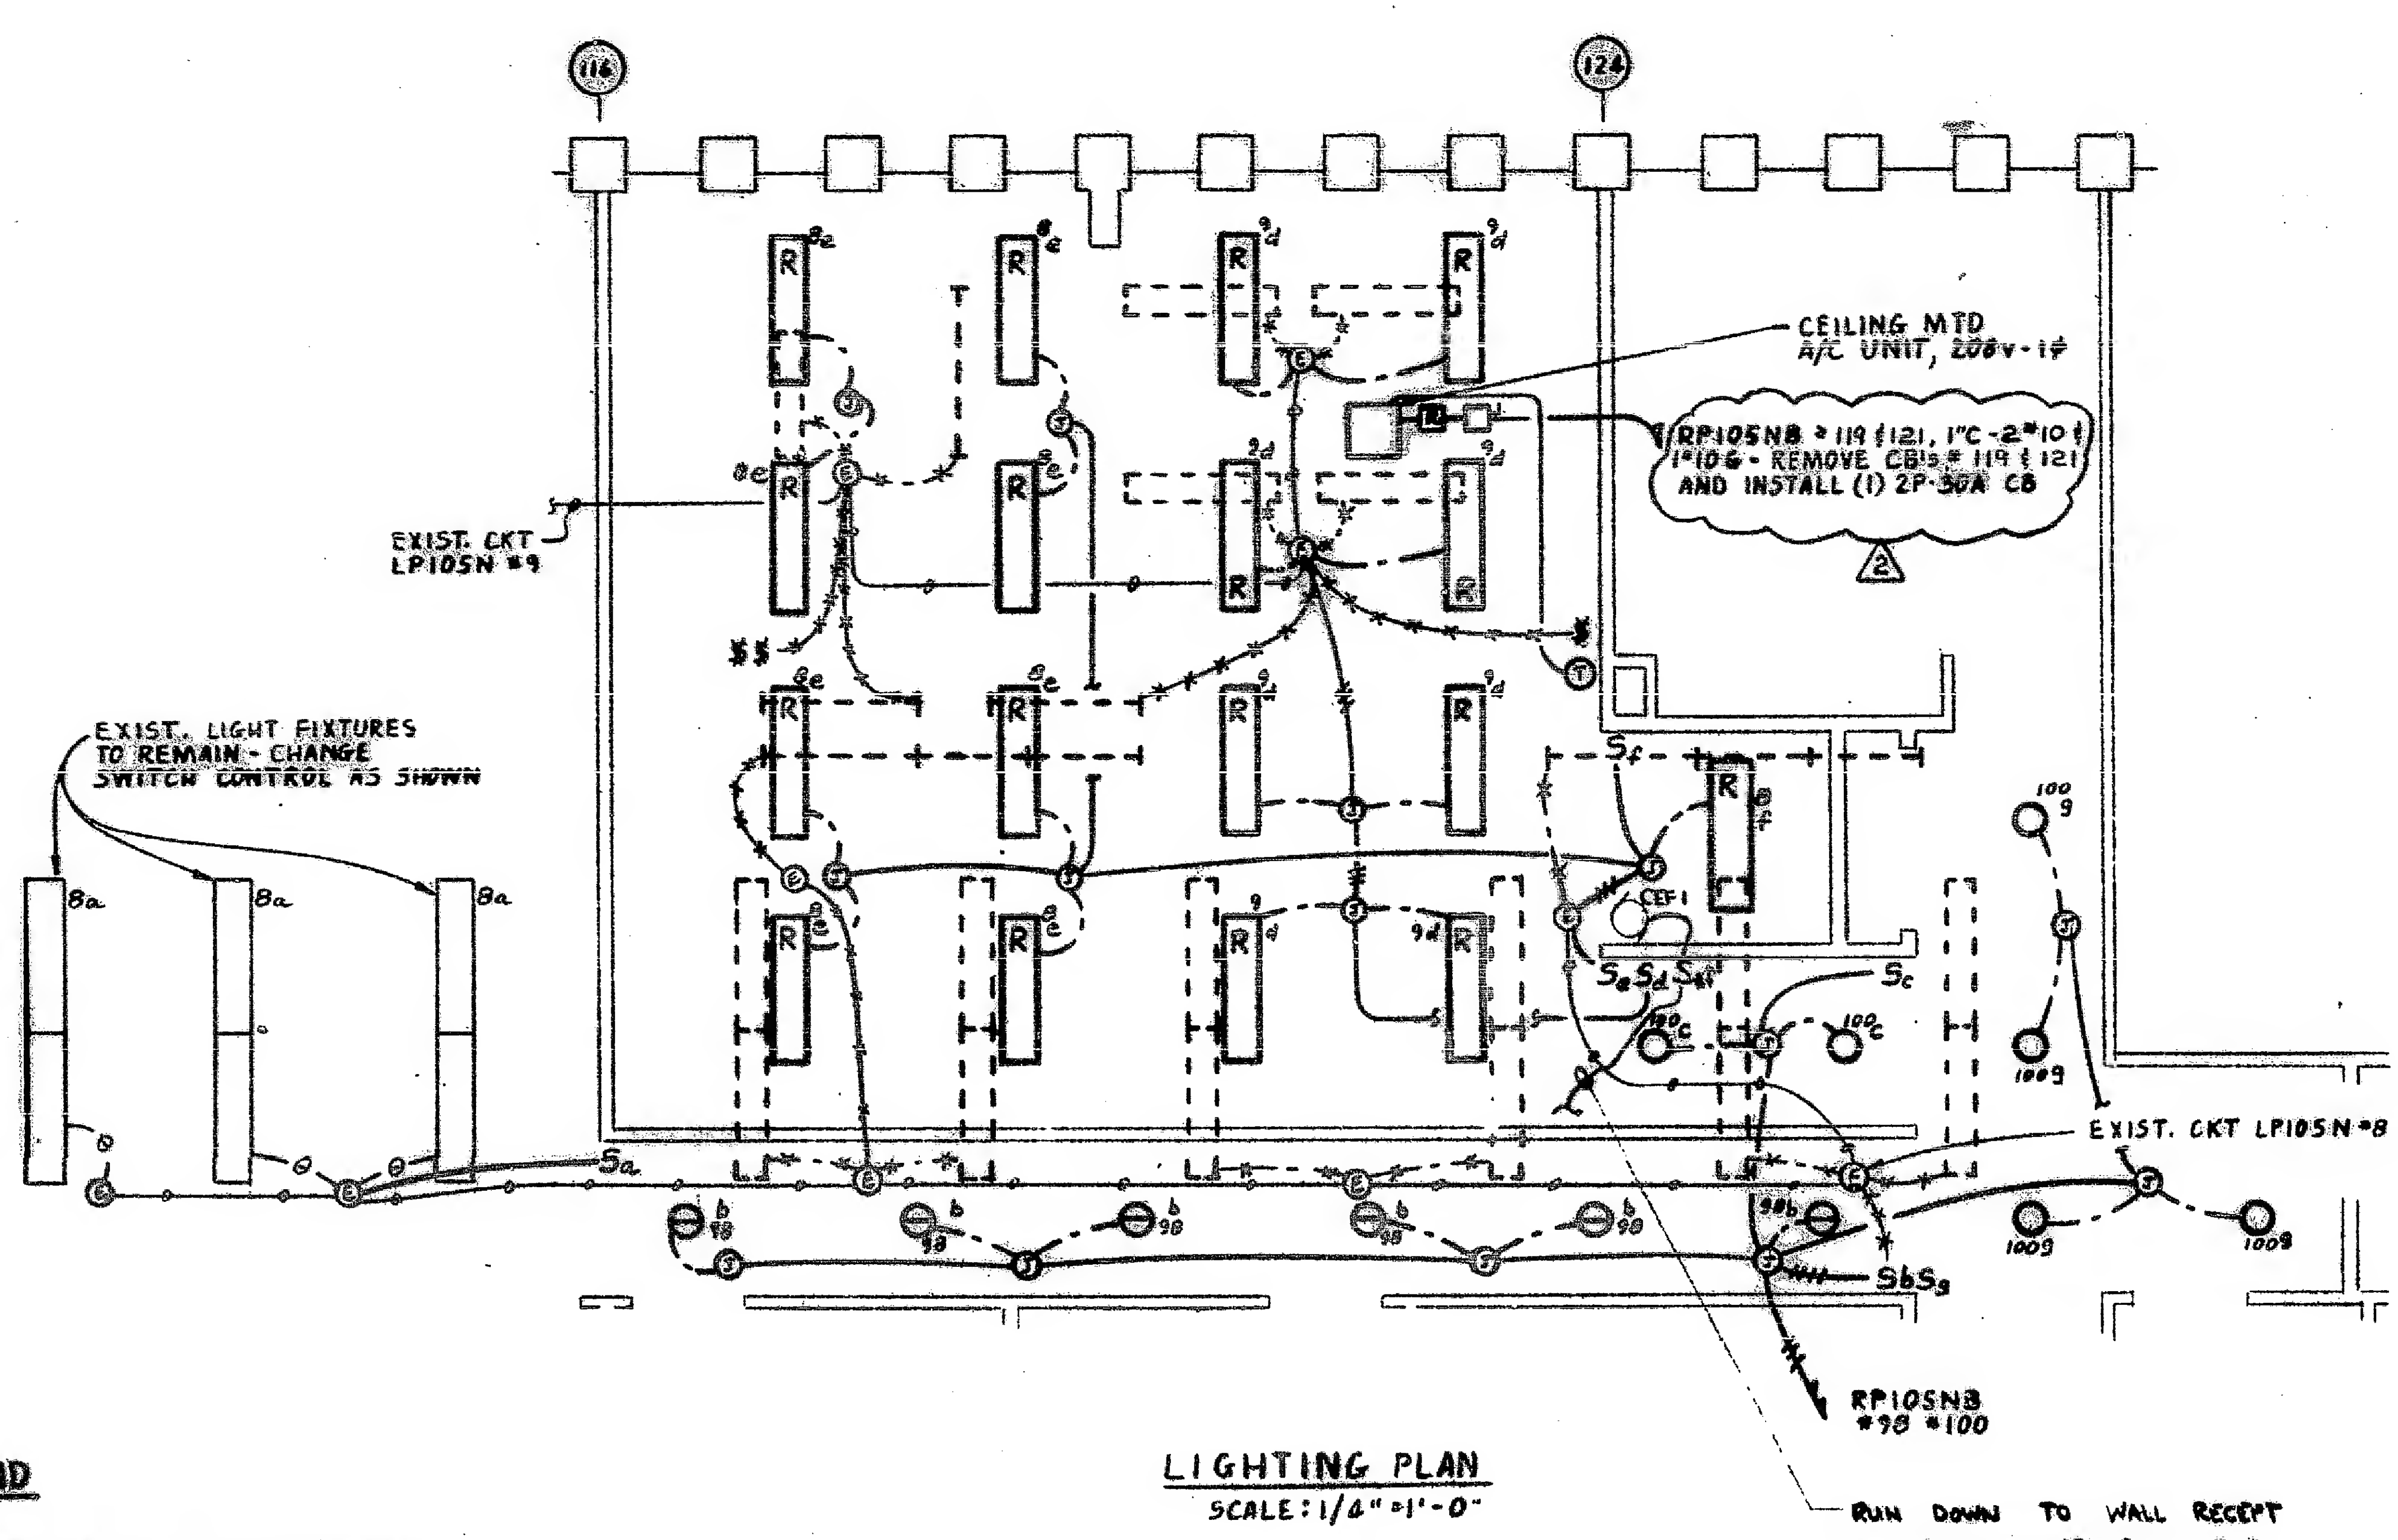

LIGHTING PLAN
SCALE: 1/4" = 1'-0"

- LEGEND**
- EXISTING STRIP LIGHT TO BE REMOVED
 - EXISTING 1x4' FLUORESCENT FIXTURE TO REMAIN
 - EXISTING 1x4' FLUORESCENT FIXTURE TO BE RELOCATED
 - RELOCATED 1x4' FLUORESCENT FIXTURE
 - RECESSED WALL WASHER - 100W
 - RECESSED DOWN LIGHT - 100W
 - EXISTING JUNCTION BOX TO REMAIN
 - JUNCTION BOX
 - EXISTING SWITCH TO BE REMOVED
 - SINGLE POLE TOGGLE SWITCH 20A-277V, WALL MTD 50" AFF, HUBBELL #211-GRAY, OR 15A-125V #101-GRAY, LETTER DENOTES CONTROL.
 - EXISTING CONDUIT & WIRING TO REMAIN
 - REMOVE EXISTING CONDUIT & WIRING
 - RIGID STEEL CONDUIT (U.L. STD #6) RUN CONCEALED
 - EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION TO REMAIN
 - REMOVE EXISTING FLEXIBLE CONDUIT & CABLE CONNECTION
 - FLEXIBLE CONDUIT & CABLE CONNECTION (U.L. STD #314)
 - HOMERUN TO PANEL INDICATED, MINIMUM SIZE 1" CDT.
 - 2x14 TEFLON SMOKE DETECTION WIRING
 - FLEXIBLE CONDUIT - MINIMUM SIZE 3/4"
 - SMOKE DETECTOR - "UF" DENOTES UNDERFLOOR MOUNTED
 - THERMOSTAT
 - KEY OPERATED SWITCH WALL MOUNTED 50" AFF, 15A-125V HUBBELL #101-L
 - EXISTING RECEPTACLE TO REMAIN
 - REMOVE EXISTING RECEPTACLE
 - WALL MOUNTED RECEPTACLE 15A-125V HUBBELL #5262
 - DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262.
 - KEY-SWITCH CONTROLLED DUPLEX RECEPTACLE MOUNTED ON WIREMOLD HUBBELL #5262.

- LEGEND (CONT'D)**
- KEY-SWITCH CONTROLLED DUPLEX RECEPTACLE - 15A-125V HUBBELL #5262
 - OPENING IN RAISED FLOOR FOR WIRING TO TRADING DESK
 - FLOOR MOUNTED DUPLEX RECEPTACLE SPLIT-WIRED FOR (2) 20A-125V CIRCUITS HUBBELL #5324. CONNECT TO FLOOR CELL WITH CDT & AFTERSET FITTING. (SEE NOTE #1 FOR AFTERSET FITTING)
 - FLOOR MTD COMBINATION TEL/DUPLEX RECEPTACLE TO BE REMOVED. REMOVE AFTERSET FITTING AND PLUG SLAB.
 - PLUGMOLD, SIZE AS INDICATED, LENGTH AS INDICATED, WITH SINGLE RECEPTS 15A-125V SPACED AS INDICATED.
 - WALL MOUNTED TELEPHONE OUTLET - CONNECT TO FLOOR CELL WITH CONDUIT AND AFTERSET FITTING (SEE NOTE #1 FOR AFTERSET FITTING)
 - TELEPHONE JACK MOUNTED TO UNDERSIDE OF TRADING DESK - PROVIDED & INSTALLED BY N.P.C.
 - 40 LINE TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. MODULAR SERIES X
 - CEF CEILING EXHAUST FAN
 - SW WALL SWITCH W/PILOT LT FOR CEF